



Grease/Grit Trap and Sample Well/Port Specifications

All grease and/or grit generating facilities within the City of Beaumont must comply with requirements specified in the City Ordinance, including installation of approved grease trap and sample well/sample port. The purpose of the sample well or sample port is to collect a wastewater sample from the discharge side of the grease or grit trap. The well must be sized to fit a one liter jar in the waste stream to collect a sufficient volume of wastewater sample. The City of Beaumont Water Utilities Department approves of the following sample well/sample port design. Any deviation from this design must be submitted in writing with a detailed plan in advance and be approved by Public Works Director or designated representative prior to installation. The City of Beaumont reserves the right to refuse or terminate water service to any facility that fails to abide by City Ordinance and the following sample well/sample port design.

Liquid Waste Flow Diagram

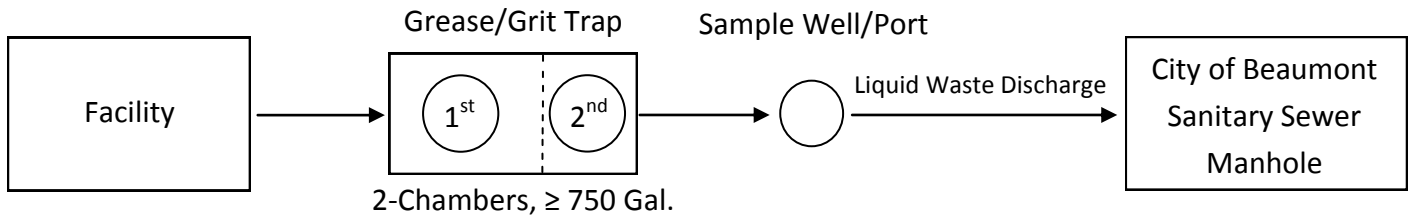

Sample Well/Port Design

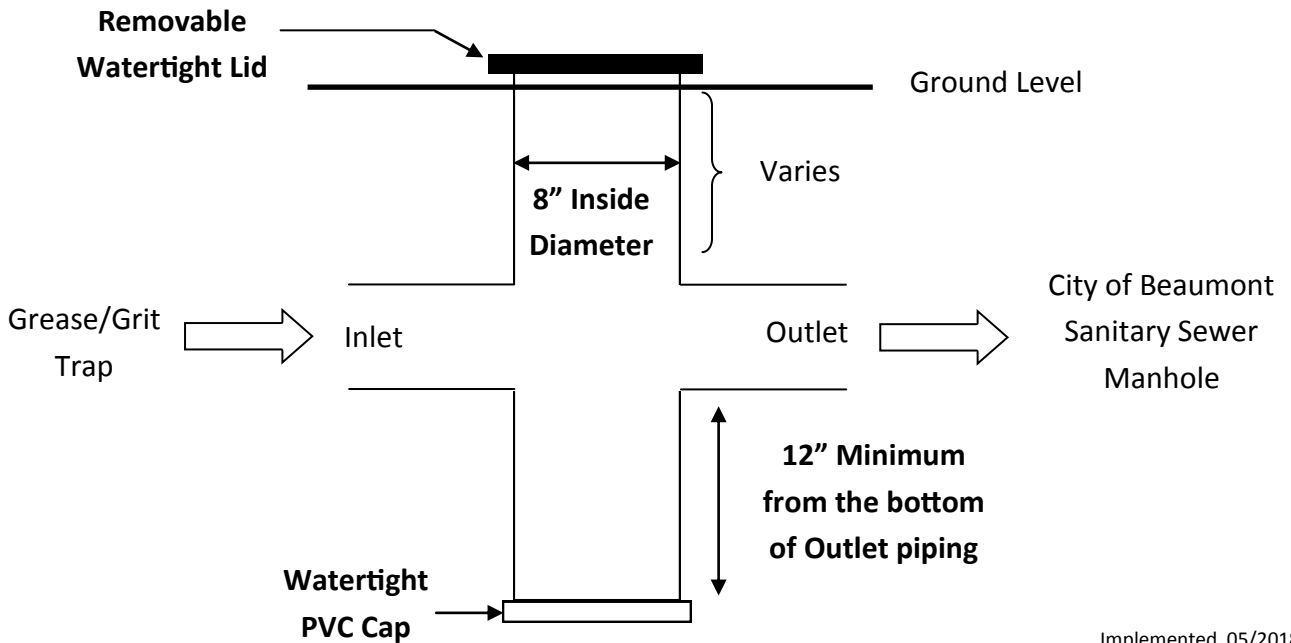

Implemented 05/2018